

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 6 June 2013	15,521 MW	15,711 MW	1.22%	
Energy Demand for 6 June 2013	326.48 GWh	328.00 GWh	0.47%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (14 May 2013)	345.42 GWh	344.42 GWh	-0.29%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

07-Jun-13


Daily Owners' Mix for 6 June 2013

TNB	75,945 MWh
IPP	249,180 MWh
Co-Gen	2,156 MWh
Interconnection*	(717) MWh

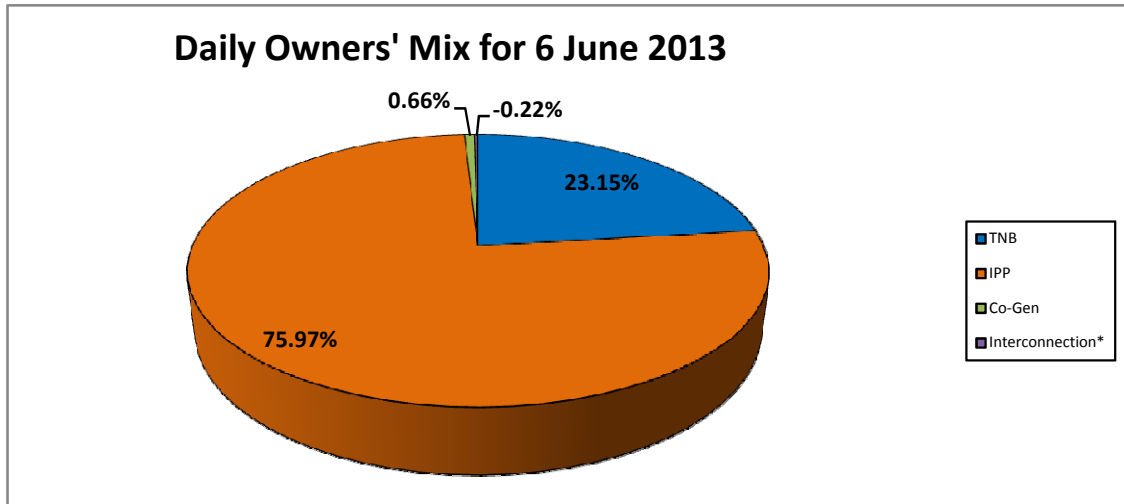

Daily Generation Mix for 6 June 2013

ST-Coal	124,799 MWh
ST-Oil	6,432 MWh
ST-Gas	- MWh
Gas	150,860 MWh
Hydro	17,052 MWh
Distillate	25,982 MWh
Co-Gen	2,156 MWh
SPORE*	(17) MWh
EGAT*	(700) MWh

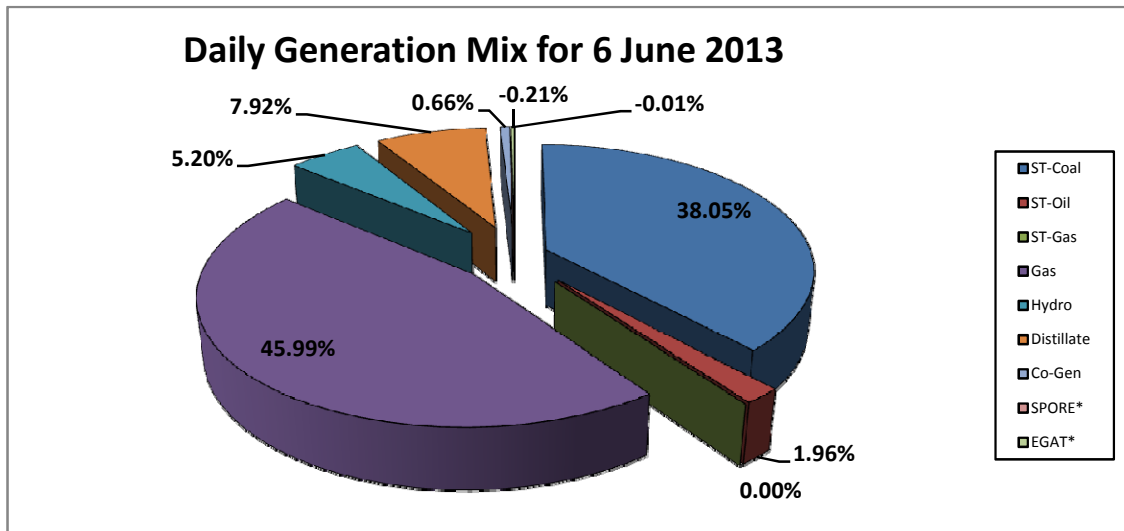

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand