

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE
Maximum Demand for 16 June 2013	13,194 MW	13,470 MW	2.09%
Energy Demand for 16 June 2013	288.42 GWh	288.18 GWh	-0.08%
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62% <b>*New MD</b>
Highest Daily Energy Demand (14 May 2013)	345.42 GWh	344.42 GWh	-0.29% <b>*New Energy</b>

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

17-Jun-13


**Daily Owners' Mix for 16 June 2013**

TNB	59,508	MWh
IPP	226,045	MWh
Co-Gen	2,059	MWh
Interconnection*	(565)	MWh

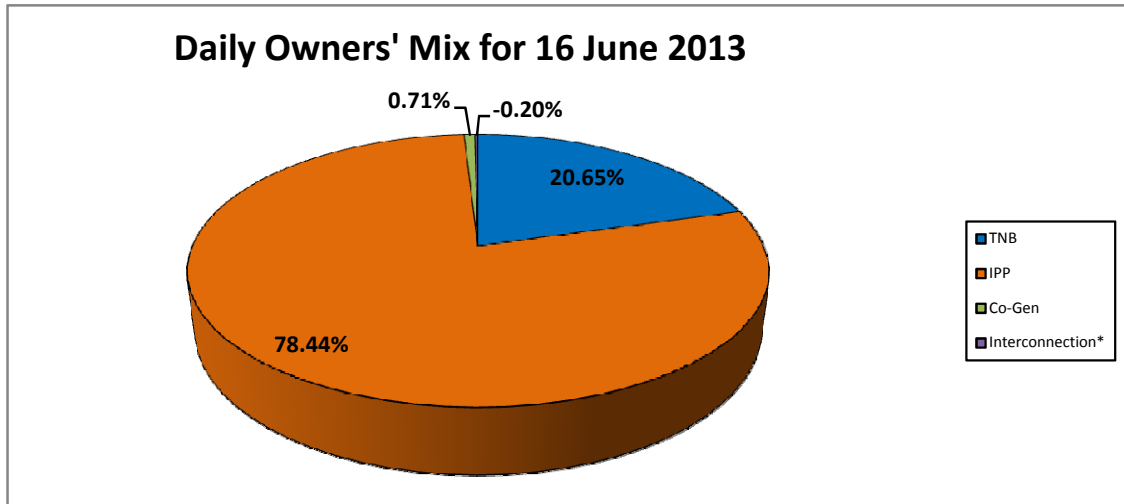

**Daily Generation Mix for 16 June 2013**

ST-Coal	134,737	MWh
ST-Oil	-	MWh
ST-Gas	-	MWh
Gas	144,151	MWh
Hydro	6,665	MWh
Distillate	-	MWh
Co-Gen	2,059	MWh
SPORE*	129	MWh
EGAT*	(694)	MWh

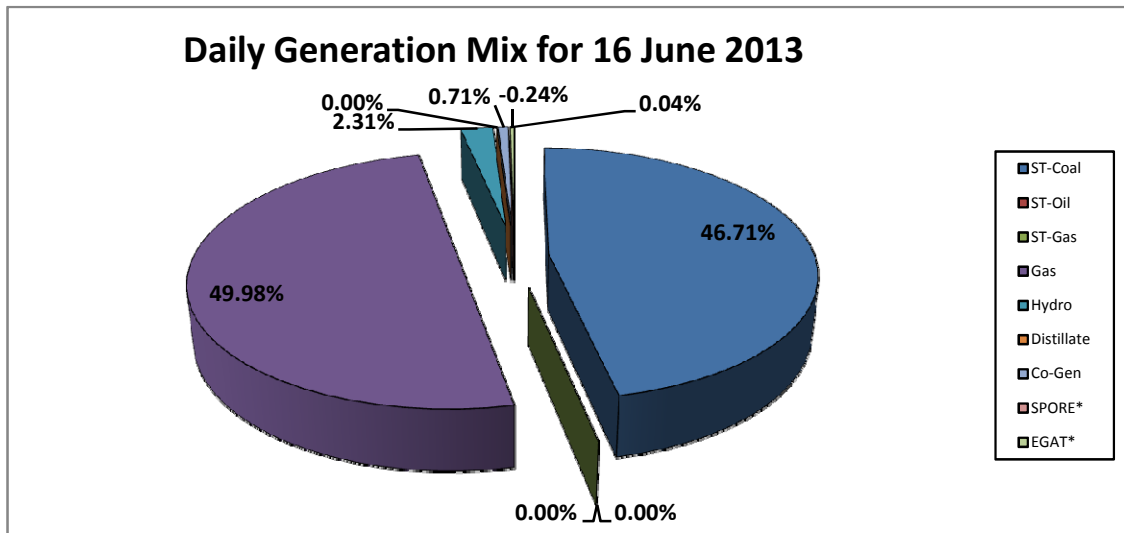

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand